

# Oregon Convention Center – LEVEL 1

Even though Portland Ballroom and Oregon Ballrooms are both located on Level 2, construction at the Oregon Convention Center prohibits traveling from one to the other while remaining on the same level. Attendees must use the temporary walkway through MLK Jr. Lobby (stairs only), or take an elevator or escalator down to Level 1 in order to travel between these ballrooms.



## DISTANCE KEY

(All distances provided are approximate)


- Meeting Rooms A to Meeting Rooms C: 380 ft.
- Ginkberry Concourse: 380 ft.
- Curved hallway around F Meeting Rooms: 152 ft.
- Hallway connecting C Meeting Rooms to Ginkberry Concourse: 132 ft.

## KEY

- ★ Main Entrances
- 🚗 Elevators
- 🏃 Escalators
- 🪜 Stairs
- 🏥 First Aid
- 💰 ATM
- 🍽 Concessions
- 👶 Lactation Suite
- 🚻 All-Gender Restrooms
- 🚹 Men's Restrooms
- 🚺 Women's Restrooms

# Oregon Convention Center – LEVEL 2

Even though Portland Ballroom and Oregon Ballrooms are both located on Level 2, construction at the Oregon Convention Center prohibits traveling from one to the other while remaining on the same level. Attendees must use the temporary walkway through MLK Jr. Lobby (stairs only), or take an elevator or escalator down to Level 1 in order to travel between these ballrooms.

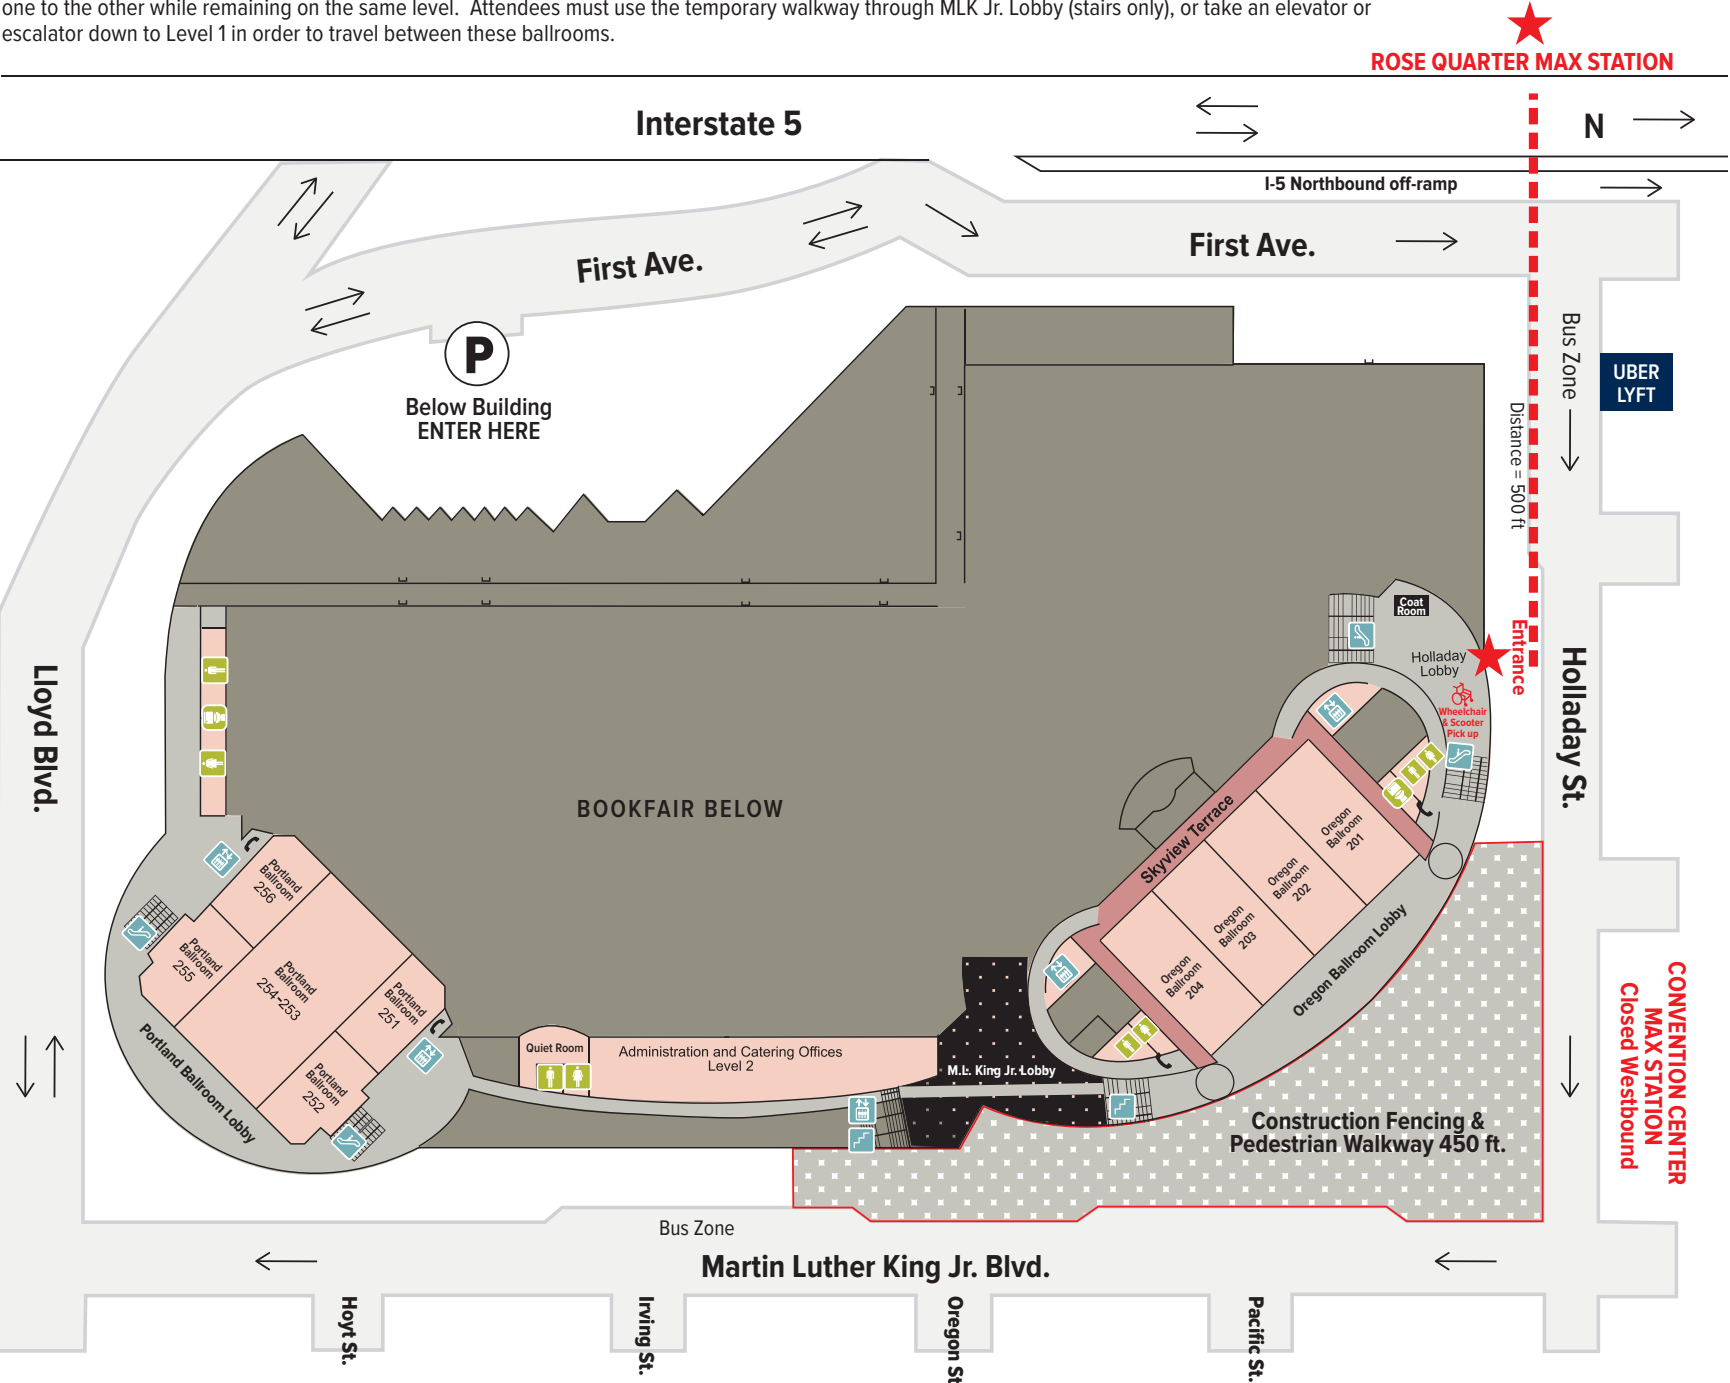

**DISTANCE KEY**  
(All distances provided are approximate)

- Oregon Ballroom Lobby: 232 ft.
- Portland Ballroom Lobby: 204 ft.
- Hallway outside of Administration & Catering Offices: 380 ft.
- Convention Center MAX to the Holladay Lobby Entrance: 330 ft.
- **LOBBY LEVEL** – MLK Jr. Lobby pathway: 160 ft.

**KEY**

- ★ Main Entrances
- 🚗 Elevators
- 🏃 Escalators
- 🪜 Stairs
- 🏥 First Aid
- 💰 ATM
- 🍽️ Concessions
- 👶 Lactation Suite
- 🚻 All-Gender Restrooms
- 🚹 Men's Restrooms
- 🚺 Women's Restrooms